


Hydesville Tower (Corporate)

tartandictionary.org/setts/dg30db6r2db2dy2db15w2/

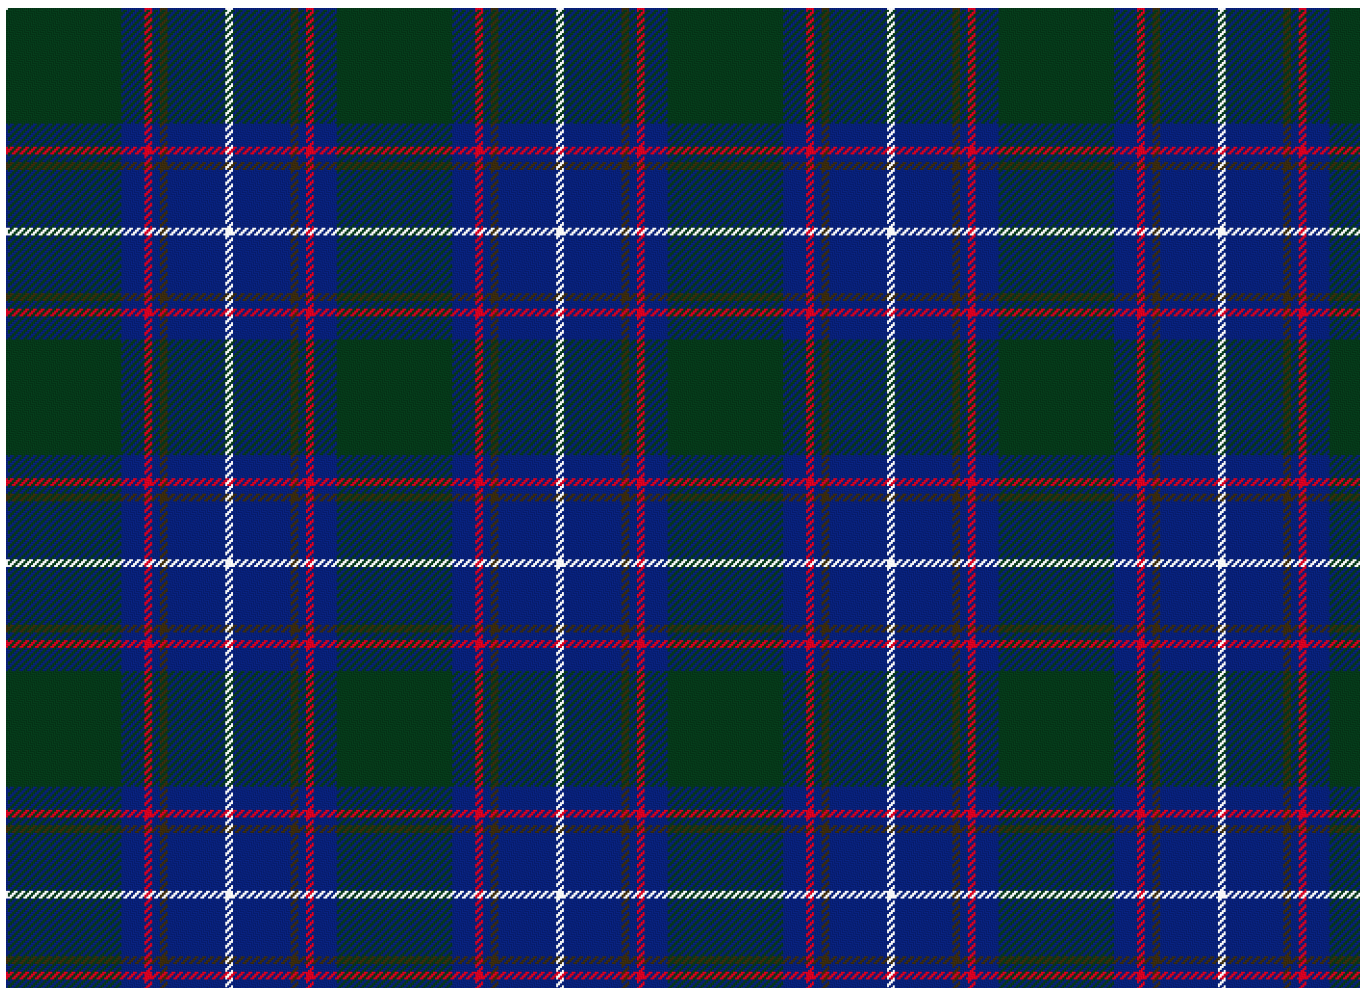

Thread count

DG/60 DB12 R4 DB4 DY4 DB30 W/4 (×2)

16 picks per cm (41 per inch) — sample reduced to fit

Palette



DB

oklch(30.0% 0.149 265.1)
#082077



DG

oklch(30.0% 0.075 151.3)
#053819



DY

oklch(30.0% 0.049 82.0)
#3A2B0D



R

oklch(55.2% 0.224 25.5)
#D60020



W

oklch(97.6% 0.000 89.9)
#F7F7F7